

WITCOMBE
CONDUIT
MAP


3/2015

SOLAR

NORTH ↑


COYOTE ↑


FARMERSVILLE

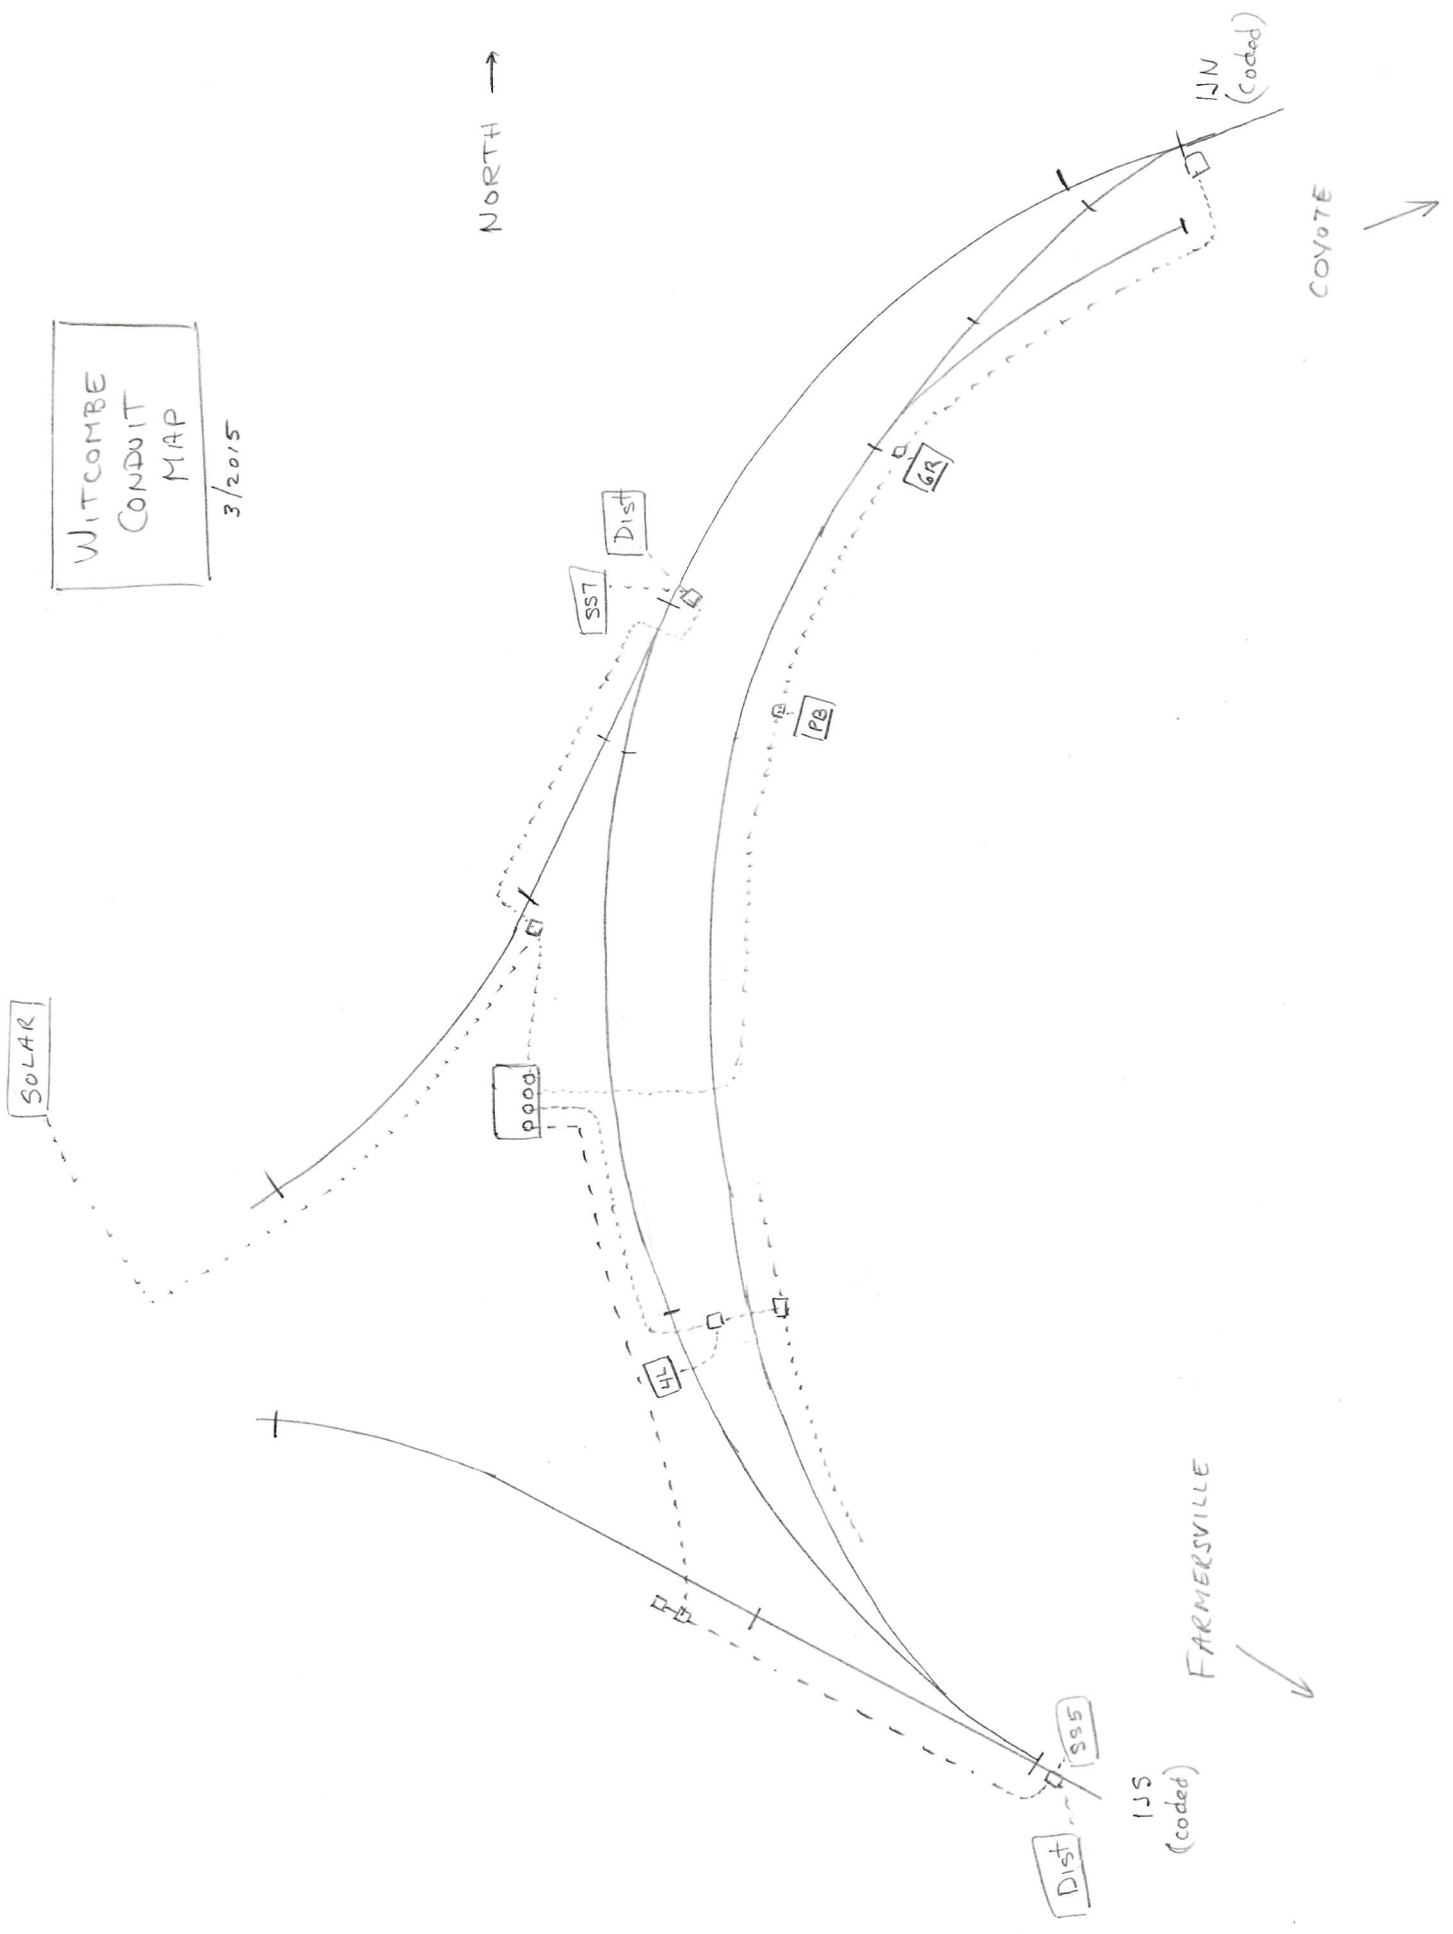


WITCOMBE
BONDING
DIAGRAM

3/2015

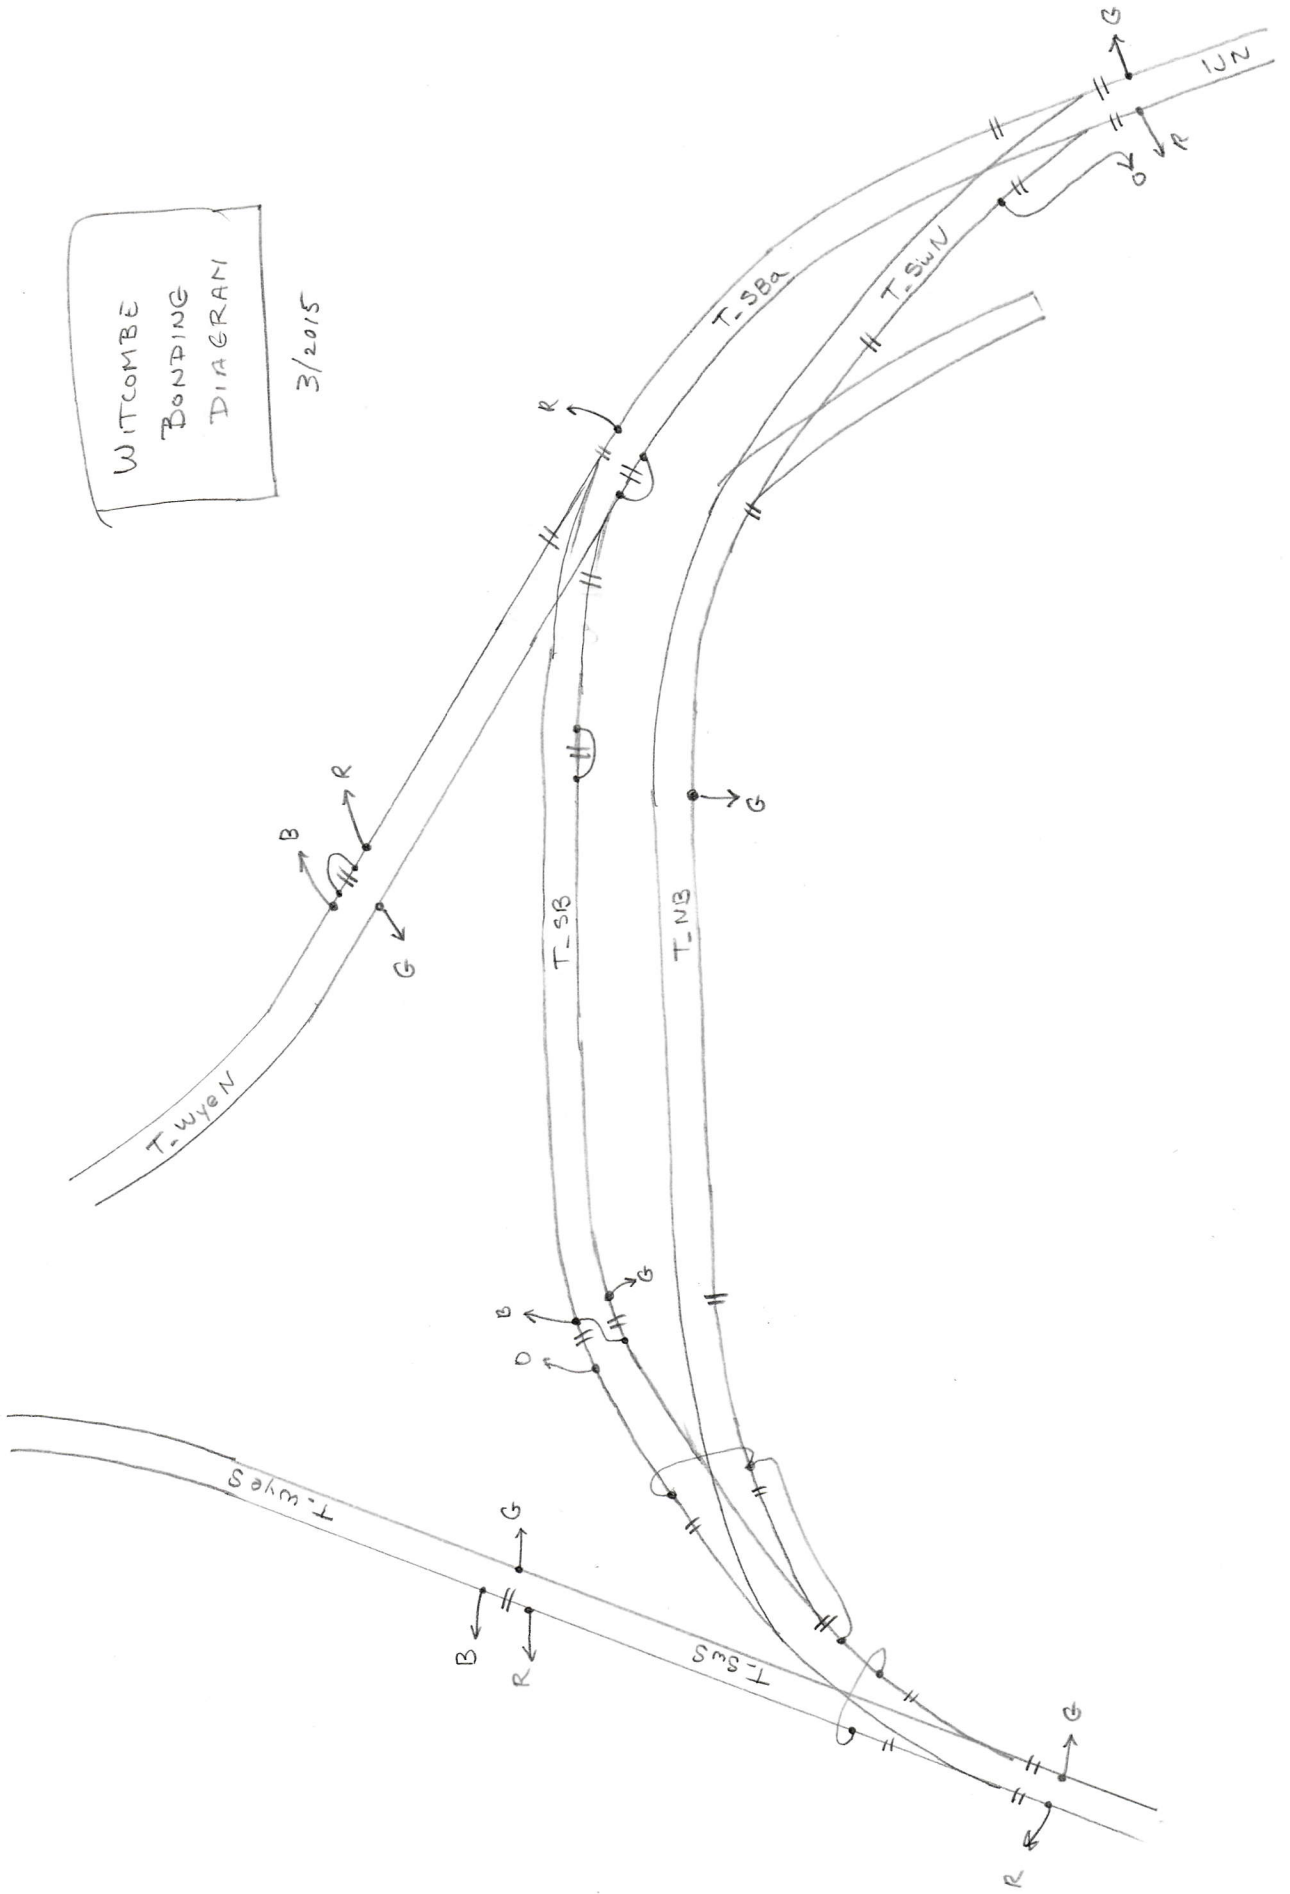

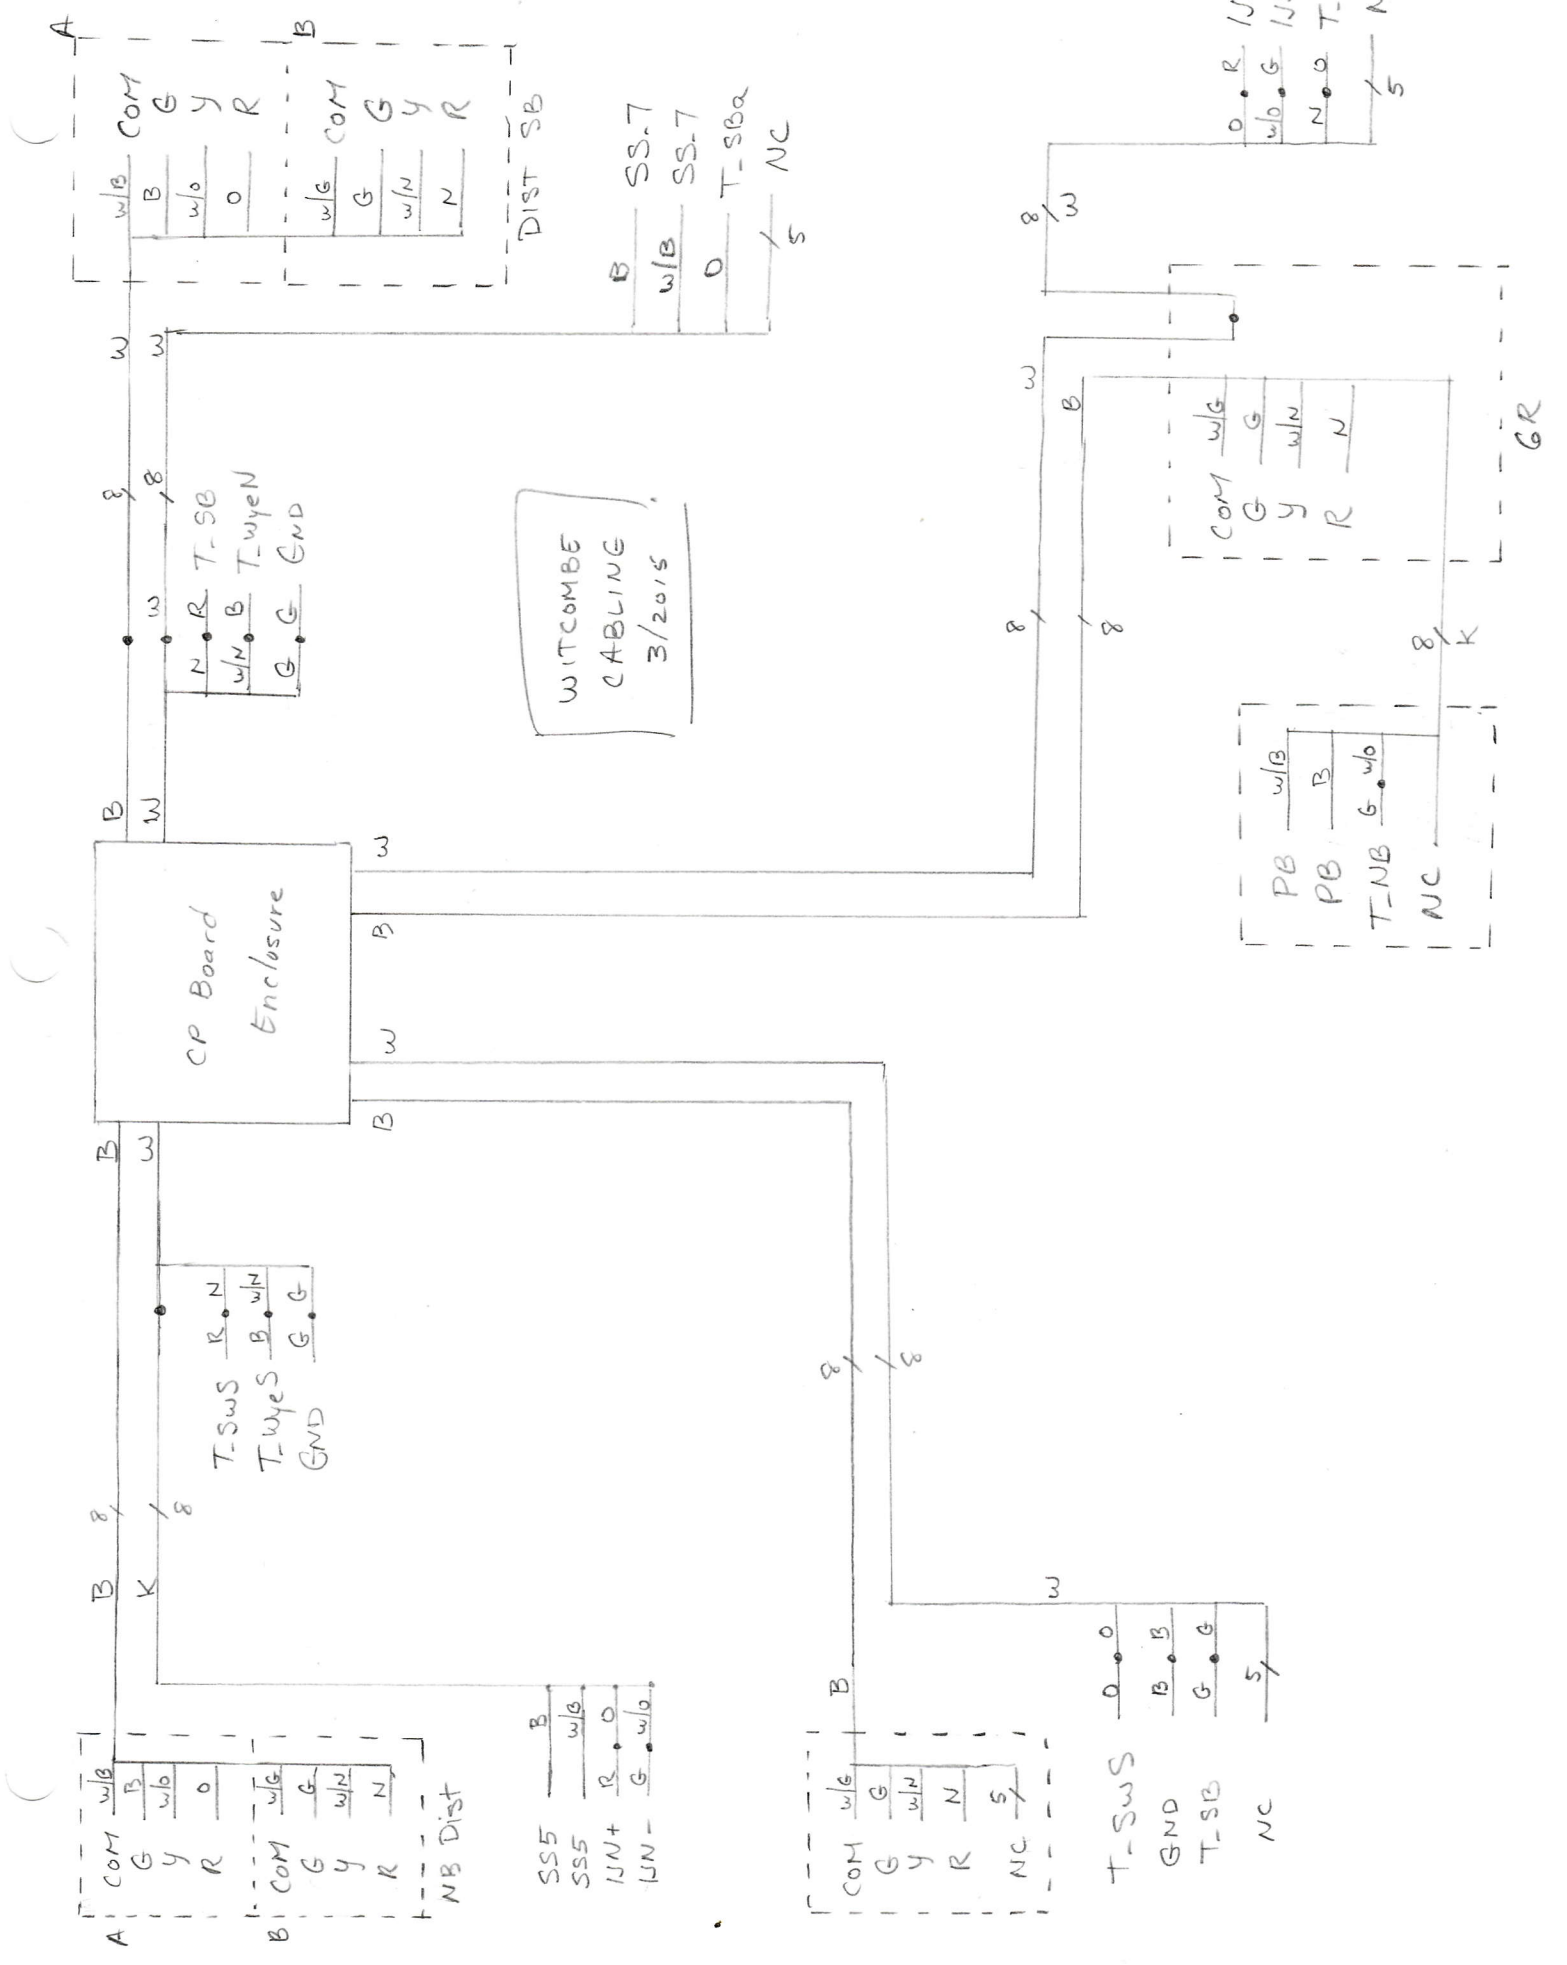

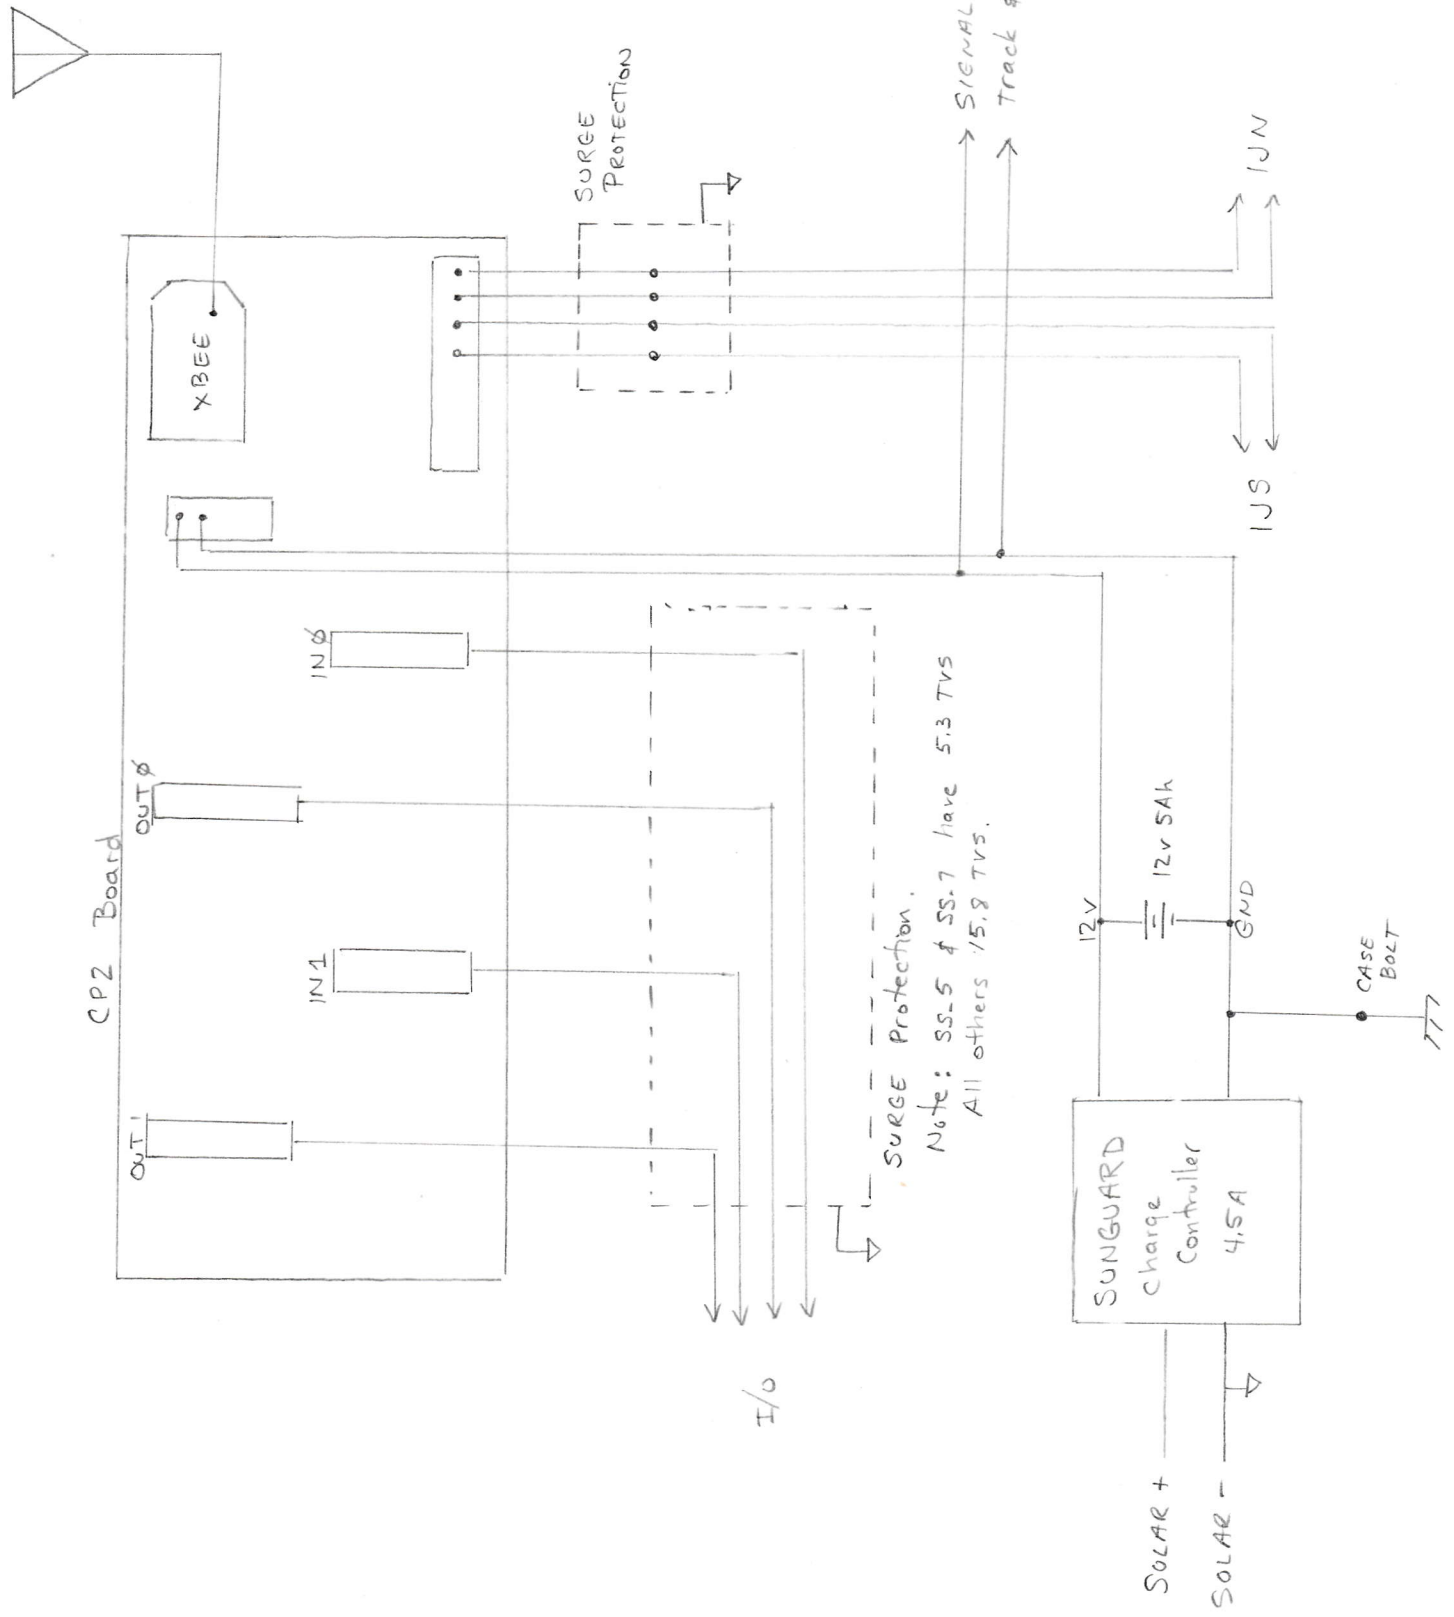


Note:
 • Two T-SwS connections wirenutted together
 • Two T-SB connections wirenutted together

SURGE Protection.
 Note: SS-5 & SS-7 have 5.3 TVS
 All others 15.8 TVS.

WITCOMBE
 CABINET

3/2015

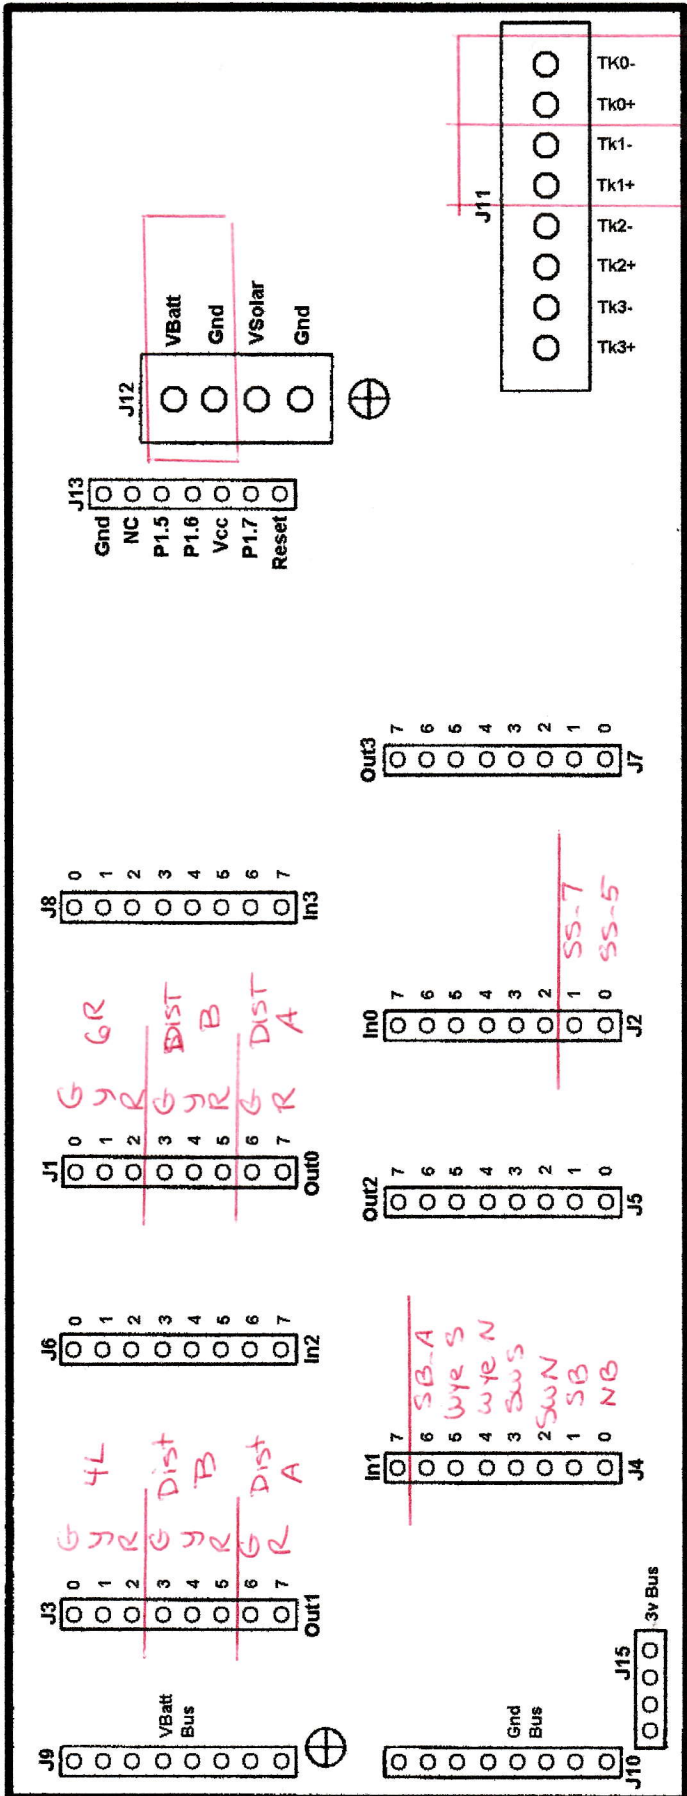

WITCOMBE
CONNECTORS

3/2015

OLD WITCOMBE
MEET
BONDING DIAG
3/2015

